


GENERAL NOTES:

1. SEE DRAWINGS E9.21.52 AND E9.21.53 FOR LIGHTING  
PANEL SCHEDULES.  
2. SEE DRAWINGS E9.30.01 AND E9.30.02 FOR FIXTURE  
SCHEDULES.

KEYED NOTES:

- N001** ALL NORMAL LIGHTING FIXTURES ON THIS DRAWING ARE CIRCUITED  
FROM PANEL 31A LOCATED IN ELECTRICAL ROOM 3-30.  
**N002** ALL EMERGENCY LIGHTING FIXTURES AND EXIT SIGNS ON THIS  
DRAWING ARE CIRCUITED FROM PANEL 35A LOCATED IN ELECTRICAL  
ROOM 3-2-66. LIGHTING IN STAIR NO. 2 TO BE CIRCUITED FROM  
PANEL 31E5A IN ELECTRICAL ROOM 31-2-31.  
**N003** ALL FIXTURES ARE MOUNTED 9'-0" A.F.F. UNLESS OTHERWISE NOTED.  
**N004** OUTSIDE PERIMETER LIGHTING FIXTURES ARE MOUNTED 7'-0" BELOW SOFFIT.  
**N005** CORRIDOR FIXTURES (W1) ARE MOUNTED 8'-0" A.F.F.  
**N006** AUDITORIUM LOBBY LIGHTING (S1) MOUNTING HEIGHT IS 8'-0" DOWN FROM FINISHED CEILING.  
**N007** LOBBY ACCENT LIGHTING MOUNTED IN LEDGES APPROXIMATELY 7'-0"  
BELOW BASIC CEILING.  
**N008** FOR AUDITORIUM LOBBY LIGHT SWITCHING, SEE ELEC. RM. 1-1-22  
ON DWG. E3.01.61.  
**N009** ATRIUM LIGHTING TRACK TO BE MOUNTED TO SKYLIGHT SUPPORTS.  
**N010** FOR LIGHTING CONTACTOR WIRING DIAGRAM, SEE E3.02.62.  
**N011** CIRCUIT OUTSIDE PERIMETER LIGHTING FIXTURES VIA LIGHTING CONTACTOR  
LCP 3-61 (CIRCUITS 9, 11) IN ELEC. RM. 3-1-4.  
**N012** FIXTURE S1 IS MOUNTED 7'-0" ABOVE CATWALK.

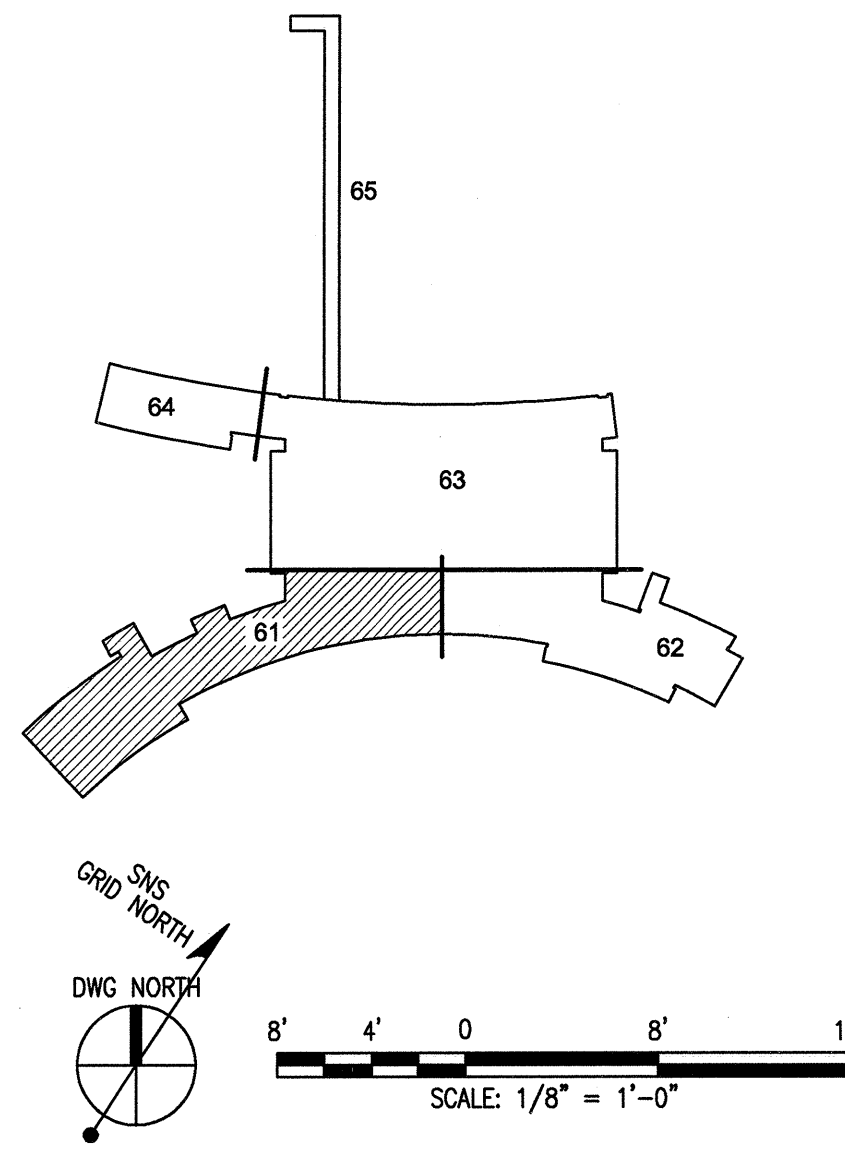

|  |   |   |   |
|--|---|---|---|
| 108031400-E8E-8600-A181  |   |   |   |
|   | Knight Jacobs Joint Venture<br>701 Scoboro Road, MS 8253<br>Oak Ridge, TN 37830<br>865-241-9433<br>Fax 865-241-3400 |  | <b>KNIGHT</b><br>Knight Advanced Technology |
| Oak Ridge National Laboratory<br>managed for the DEPARTMENT OF ENERGY under<br>U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725<br>UT-BATTELLE, LLC • Oak Ridge, Tennessee |   |   |   |

|     |     |          |          |
|-----|-----|----------|----------|
| RPE | DSN | T. WHITE | 12/20/01 |
|     | DRW | T. WHITE | 12/20/01 |
|     | CHK | K.SZOT   | 12/20/01 |